

fire stopping and insulation

Suppliers of passive fire products, acoustic and specialist insulation Manufacturers of the Safire * Fire Stopping Range

| Uniclass | | EPIC | |
|----------|---|------|---|
| CI/SfB | | | |
| | L | L | I |

PYROUPLEX® PIPE WRAPS



Pyroplex® Pipe Wraps seal closed flammable pipes from 55mm to 160mm diameter and are located inside a wall or floor structure.

- Fire rating up to 4 hours.
- Intumescent is totally unaffected by water.
- Intumescent is robust 'non-flaking' and difficult to tear.
- Identification on each product for full traceability.
- Simple to use easy to install.





QBM, Unit 5C, Grange Avenue, Baldoyle Ind. Est., Baldoyle, Dublin 13.






Suitable for fitting to:

Concrete, masonry and porous concrete wall constructions.

Concrete floor construction.

Waste water and fresh water plastic pipes.

Examples of Wraps Locations:

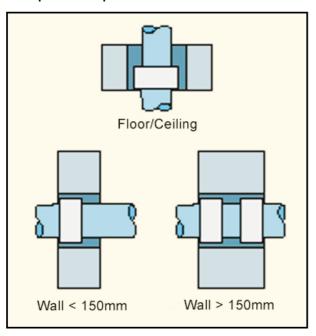

Wraps sizes:

| Part Number | Pipe Outside Diameter (mm) | Wrap Length (mm) | Diameter of Hole in Wall or Floor (mm) |
|----------------|----------------------------------|------------------------|--|
| PPW 55 | 65 | 175 | 70 |
| PPW 82 | 82 | 260 | 98 |
| PPW 110 | 110 | 350 | 130 |
| PPW 125 | 125 | 470 | 155 |
| PPW 160 | 160 | 506 | 190 |

Installation Instructions

- 1. The wall or floor must be of solid construction. The recess hole must be the correct size. See table above.
- 2. Fix wrap around the pipe using adhesive tab and slide along pipe into wall/floor cavity to a depth of 5mm min./10mm max.
- 3. After insertion the cavity around the pipe can be made good with filler. The surface can then be decorated.
- 4. The identification label should be attached to the pipe to show a wrap has been fitted.

Testing

Tested BS476 Part 20:1987 and other International Standards.
Health & Safety
According to 91/155/EEC Revision No.1.

On-Site Support

A comprehensive design, advice and support service is offered to architects, specifiers and contractors ensuring trouble free installation.

| Your distributor: | |
|-------------------|--|
| | |
| | |
| | |
| | |
| | |
| | |
| | |



